


OFFICIAL TEST REPORT

(FBC, IBC: 2012, 2015, 2018, ANSI Z97.1, ASTM E2353 – E2358)

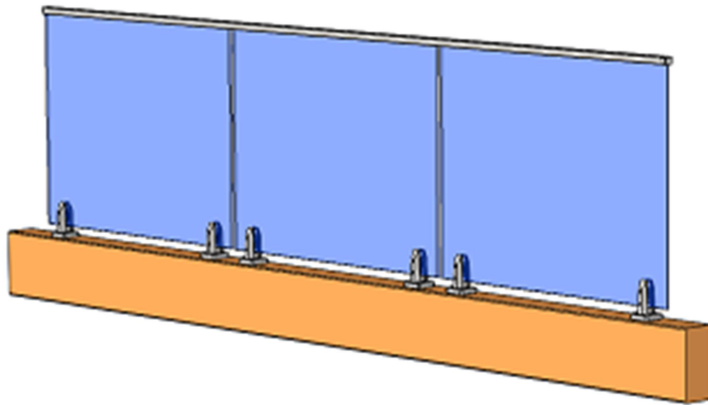

February 22, 2020

Report Number: Viewrail-07-2020

Manufacturer: Viewrail

Test Location: 2436 Dierdorf Road
Goshen, IN 46526

Product Under Test: H&G Talon –
Surface Mount

Test Witnessed By: Michael Hudson, P.E.
JJ. Johnson (Manufacturer)

The H&G Surface Mount Talon system is an interior glass rail/ guard/balustrade assembly with full view glazing material that is a point and clamp supported with a structural top rail.

Notes

This report does not purport to address all possible impact and load cases that could result in railing system or glazing failure. If additional load or impact case testing is required by the qualified licensed engineer, please contact the Manufacturer.

For external installations the wind loads and glass stress must be calculated and accounted for by a qualified licensed engineer in charge of the fixed work. Further, If the system will be installed in exterior locations, corrosion and deterioration testing is required.

The test results herein are intended to assist a qualified licensed engineer in developing a code compliant guard that meets the applicable requirements of 2012, 2015, and 2018 International Building Code and state codes adopted from the IBC codes. This report is not intended to demonstrate the code compliance of an installation but is only to be utilized by the qualified licensed engineer in charge in analyzing the glass stresses and anchorage.

H&G Surface Mount Talon Glass Baluster Test Report

Signature Page

Michael Hudson, PE
1725 Unicoi Road
Nashville, NC 27856

252-382-1884
mHUDSON.bsme@yahoo.com

Referenced Codes and Standards



ASTM International

- E2353 - 16 *Standard Test Methods for Performance of Glazing in Permanent Railing Systems, Guards, and Balustrades*¹
- E935 - 13^{ε1} *Standard Test Methods for Performance of Permanent Metal Railing Systems and Rails for Buildings*²
- E2358 - 17 *Standard Specification for Performance of Glazing in Permanent Railing Systems, Guards, and Balustrades*⁴
- E2025 - 99 *Standard Test Method for Evaluating Fenestration Components and Assemblies for Resistance to Impact Energies*³
1. This standard is issued under the fixed designation E2353; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon (ε) indicates an editorial change since the last revision or reapproval. Current edition approved Feb. 15, 2016. Published March 2016. Originally approved in 2004. Last previous edition approved in 2014 as E2353 - 14. DOI:10.1520/E2353-16.
 2. This standard is issued under the fixed designation E935; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon (ε) indicates an editorial change since the last revision or reapproval.

ε1 NOTE—Section 1.2 was editorially revised in October 2013.
 3. This standard is issued under the fixed designation E2025; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon (ε) indicates an editorial change since the last revision or reapproval.

(Reapproved 2006)
NOTICE: This standard has been withdrawn, however other active standards still reference this standard.
 4. This standard is issued under the fixed designation E2358; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon (ε) indicates an editorial change since the last revision or reapproval. This specification is under the jurisdiction of ASTM Committee E06 on Performance of Buildings and is the direct responsibility of Subcommittee E06.56 on Performance of Railing Systems and Glass for Floors and Stairs. Current edition approved Aug. 1, 2017. Published September 2017. Originally approved in 2004. Last previous edition approved in 2010 as E2358 - 04(2010). DOI: 10.1520/E2358-17.



American National Standards Institute

- Z97.1-2015 *For safety glazing materials used in buildings –safety performance specifications and methods of test*



Consumer Product Safety Commission

- 16 CFR Ch. II
(1-1-12 Edition) *Part 1201 – Safety Standard for Architectural Glazing Materials*



International Code Council

- 2018, 2015, and 2012 International Building Code® (IBC)
2018, 2015, and 2012 International Residential Code® (IRC)

Railing System Components and Hardware

Glazing Material

Manufacturer:	ViewRail – Goshen, Indiana
Overall Glazing Thickness:	½" (Nominal)
Glazing Type:	Tempered Transparent Glass (TTG)
Thickness Standard:	ASTM C1036
CPSC 16 CFR Part 1201 Category:	II ¹
ANSI Z97.1 Class:	A ¹

¹ Intertek Test Report Number K1004.02-119-37 (See Appendix A)

Glazing material has been tested and shown to meet the following minimum material requirements:

Category II (CPSC 16 CFR Part 1201)
Class A (ANSI Z97.1 Class)

As required by:

Section 2407.1 of IBC (2018, 2015, 2012)
Section R308.4 of IRC (2018, 2015, 2012)
Section 3.3.1 of ICC-ES AC439

Substitution Note: In accordance with ASTM E2358-17, section 8:

8. Permissible Variations and Substitutions:

8.2 Laminated glass shall be permitted to be substituted for tempered glass provided the structural loads (frame loads) are met and the nominal thickness is achieved with a minimum interlayer capable of passing ANSI Z97.1 Class A.

Components and Hardware

Component and assembly drawings contained in Appendix B. The glass rail, guard, and balustrade assembly was installed in the test fixture in accordance with the manufacturers written installation instructions as contained in Appendix C. All test specimens were conditioned as required by ASTM E2353-16 prior to testing.

Substitution Note: In accordance with ASTM E2358-17, section 8

8. Permissible Variations and Substitutions:

8.4 Larger systems shall qualify smaller systems provided there is no change to the attachment, anchoring or any other property that would decrease the structural performance of the system.

ASTM System Classification

The H&G Surface Talon railing system is a hybrid Edge Clamping Point Supported Glazing System classification of Type III (FIG 5b) and of Type VI (FIG 8) as defined by ASTM E2358-17:

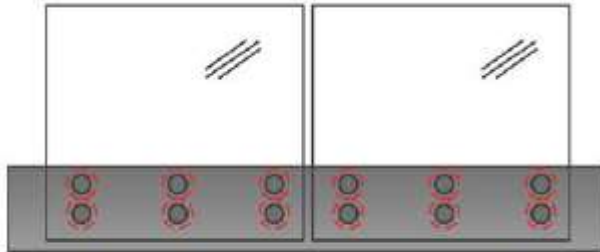


FIG. 8 Type VI: Point Supported Only—Glazing as Structural Member


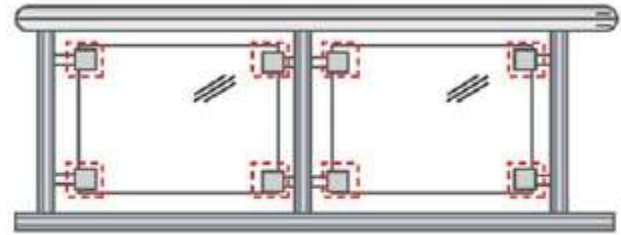


FIG. 5 b Type III: Edge Clamping Glazing System—Glazing as In-fill (continued)

With an attached structural top rail:

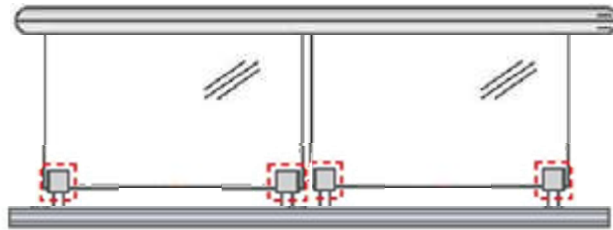

Instrumentation

Equipment Description	Manufacturer	Model/Part Number
Load Cell	Zemic	H3-C3-1.5t-3B
Digital Readout	Scientific Industries	FB 10k
Laser Deflection Sensor	Keyence	IL-300
Actuator	McMaster-Carr	6211K74

Note

All test instruments were calibrated and are traceable to the International System of Units (SI) through the National Institute of Standards and Technology (NIST) or another National Measurement Institute or through consensus standards. ViewRail calibration providers meet the requirements of ISO 17025:2005.



Testing Preparation

Test Sequence (All tests performed on a single specimen in the order specified by ASTM E2353-16 and ASTM E935-13)

1. Infill Load Test
 - Vertical Edge of Center Lite
 - i. 4" x 4"
 - ii. 12" x 12"
2. Concentrated Load Test
 - i. Horizontal - Mid-Span of Handrail

Calculated Permissible Deflection

Permissible deflection under load per ASTM 2358-17 calculated under worst case conditions (minimize h or l value):

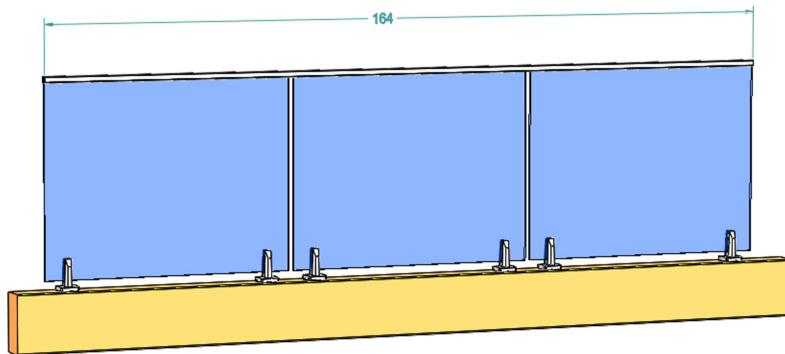

Maximum Permissible Deflection

Horizontal Load Applied at Rail
Mid-Span

$$\begin{aligned} & h/24 + l/96 \\ & (36''/24 + 164''/96) \\ & 1.5'' + 1.7'' \\ & 3.2'' \end{aligned}$$

Maximum Permissible Deflection

Load Applied at the Line of
Vertical Support


$$\begin{aligned} & h/12 \\ & 36''/12 \\ & 3'' \end{aligned}$$

Maximum Permissible Deflection
Vertical Load Applied at Rail Mid-Span

$$\begin{aligned} & l/96 \\ & 164''/96 \\ & 1.7'' \end{aligned}$$

Testing: Results


Concentrated Horizontal Load: Rail Mid-span

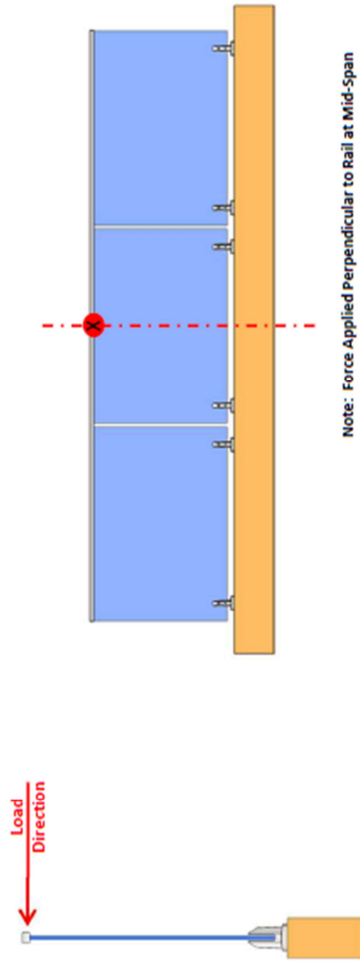

Note: Force Applied Perpendicular to Rail at Mid-Span

Horizontal Load		Permissible Deflection
Force	Measured Deflection	$h/24 \pm 1/96$
[lbf]	[mm]	[in]
0	0	3.2
20	2.7	3.2
50	5.9	3.2
100	11	3.2
150	16	3.2
200	21.3	3.2
250	27.3	3.2
300	31	3.2
365	38.2	3.2
400	43.4	3.2
450	49.2	3.2
500	54.6	3.2
550	61.4	3.2
600	68.7	3.2
650	75.4	3.2
700	81.7	3.2
750	88.9	3.2
800	96.2	3.2

Concentrated Horizontal Load: Rail Mid-span

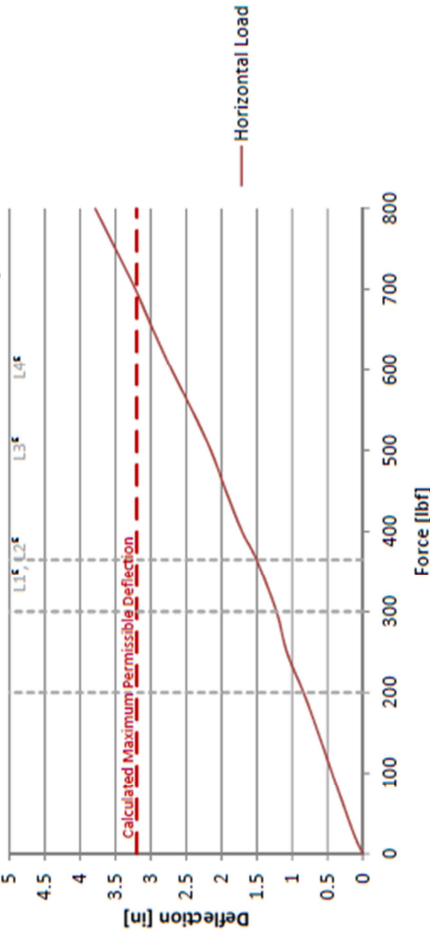

* Structural Performance: Concentrated Load Performance Level (Per ASTM E2350-17)


Structural Retention: Glazing Completely Retained, Glass Unbroken

Maximum Observed Deflection: < 3.0 at Critical Point of Load Application (@ 650 lbf)

Maximum Load: System Supported 650 lbf (Structural Performance Concentrated Load Level L4) [Load Duration-300 sec]

RESULTS

Infill Horizontal Load - Vertical Edge of Center Lite

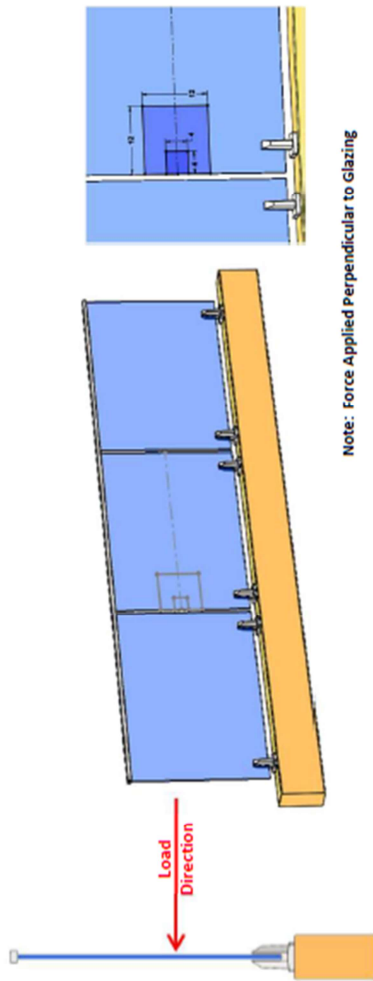


Note: Force Applied Perpendicular to Glazing

4 in ² Infill		Permissible Deflection
Force [lbf]	Measured Deflection [mm]	$h/12$ [in]
0	0	3
20	1.3	3
50	2.5	3
100	4.4	3
150	6	3
200	8	3
250	9.7	3
300	12.1	3

12 in ² Infill		Permissible Deflection
Force [lbf]	Measured Deflection [mm]	$h/12$ [in]
0	0	3
20	0.8	3
50	1.5	3
100	3.7	3
150	5.5	3
200	6.9	3
250	8.5	3
300	10.1	3

Infill Horizontal Load- Vertical Edge of Center Lite

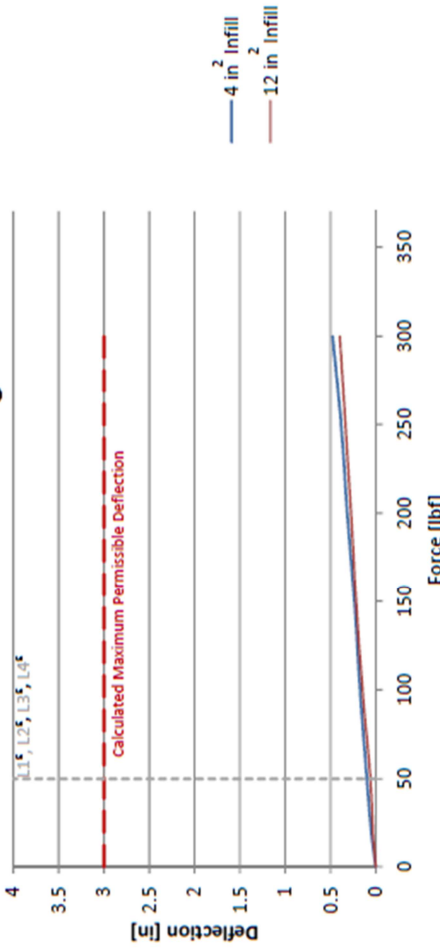

Structural Performance: Infill Horizontal Load Performance Level (Per ASTM E2358-17)

Structural Retention: Glazing Completely Retained, Glass Unbroken
Maximum Observed Deflection: < 0.48 in at Critical Point of Load Application
Maximum Load: System Supported 300 lbf (Structural Performance Infill Horizontal Load Level L1-L4) [Load Duration-300 sec]

Structural Retention: Glazing Completely Retained, Glass Unbroken
Maximum Observed Deflection: < 0.4 in at Critical Point of Load Application
Maximum Load: System Supported 300 lbf (Structural Performance Infill Horizontal Load Level L1-L4) [Load Duration-300 sec]

RESULTS

4 in² Infill

12 in² Infill

Appendix A – Glazing Impact Test Report



VIEWRAIL TEST REPORT

SCOPE OF WORK
IMPACT TESTING ON TEMPERED TRANSPARENT SAFETY GLAZING MATERIAL

REPORT NUMBER
K1004.02-119-37

TEST DATE(S)
08/28/19

ISSUE DATE
09/03/19

PAGES
5

DOCUMENT CONTROL NUMBER
RT-R-AMER-Test-2881 (02/25/19)
© 2017 INTERTEK





TEST REPORT FOR VIEWRAIL
Report No.: K1004.02-119-37
Date: 09/03/19

130 Derry Court
York, Pennsylvania 17406

Telephone: 717-764-7700
Facsimile: 717-764-4129
www.intertek.com/building

REPORT ISSUED TO

VIEWRAIL
1755 Ardmore Court
Goshen, Indiana 46526

SECTION 1

SCOPE

Intertek Building & Construction (B&C) was contracted by Viewrail - Goshen, Indiana to perform safety glazing impact testing in accordance with ANSI Z97.1, CAN/CGSB 12.1, and CPSC 16 CFR 1201 on tempered transparent glass. Results obtained are tested values and were secured by using the designated test methods. Testing was conducted at the Intertek B&C test facility in York, Pennsylvania.

This report does not constitute certification of this product nor an opinion or endorsement by this laboratory. Intertek will service this report for the entire test record retention period. The test record retention period ends four years after the test date. Test records, such as detailed drawings, datasheets, representative samples of test specimens, or other pertinent project documentation, will be retained for the entire test record retention period.

SECTION 2

SUMMARY OF TEST RESULTS

SPECIMEN NUMBER	1	2	3	4
IMPACT TEST RESULTS	Pass	Pass	Pass	Pass
THICKNESS COMPLIANCE	Pass	Pass	Pass	Pass

For INTERTEK B&C:

COMPLETED BY: Todd M. Wilt
TITLE: Lead Technician

SIGNATURE: 
Digitally signed by: Todd M. Wilt on 09/03/19
DATE: 09/03/19
tmw:vtm/aas

REVIEWED BY: Virgal T. Mickley, Jr., P.E.
TITLE: Senior Staff Engineer

SIGNATURE: 
Digitally signed by: Virgal T. Mickley, Jr. on 09/03/19
DATE: 09/03/19



2019.09.04 10:20:13 -04'00'

This report is for the exclusive use of Intertek's Client and is provided pursuant to the agreement between Intertek and its Client. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. Intertek assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense or damage occasioned by the use of this report. Only the Client is authorized to permit copying or distribution of this report and then only in its entirety. Any use of the Intertek name or one of its marks for the sale or advertisement of the tested material, product or service must first be approved in writing by Intertek. The observations and test results in this report are relevant only to the sample(s) tested. This report by itself does not imply that the material, product, or service is or has ever been under an Intertek certification program.





130 Derry Court
York, Pennsylvania 17406
Telephone: 717-764-7700
Facsimile: 717-764-4129
www.intertek.com/building

TEST REPORT FOR VIEWRAIL
Report No.: K1004.02-119-37
Date: 09/03/19

SECTION 3 TEST METHODS

The specimens were evaluated in accordance with the following:

ANSI Z97.1-2015, *For safety glazing materials used in buildings - safety performance specifications and methods of test*, American National Standard

CAN/CGSB 12.1-2017, *Safety Glazing*, National Standard of Canada

CPSC 16 CFR 1201, *Safety Standard for Architectural Glazing Materials*, Consumer Product Safety Commission (Version: 2012; Source: 42 FR 1441, Jan. 16, 1977)

SECTION 4 MATERIAL SOURCE

Test samples were obtained from the manufacturer. The specimens were received on 08/23/19, in good condition and suitable for testing unless noted otherwise.

SECTION 5 SAMPLE RETENTION

All test specimens were destroyed by test or by personnel and have been disposed of as trash. Representative sections of the samples will be retained for up to 30 days from the date of report issuance. After 30 days, representative samples will be automatically discarded.

SECTION 6 LIST OF OFFICIAL OBSERVERS

NAME	COMPANY
Todd M. Wilt	Intertek B&C



Total Quality. Assured.

TEST REPORT FOR VIEWRAIL
Report No.: K1004.02-119-37
Date: 09/03/19

130 Derry Court
York, Pennsylvania 17406

Telephone: 717-764-7700
Facsimile: 717-764-4129
www.intertek.com/building

SECTION 7

TEST PROCEDURE

Overview

All specimens were impacted once from the select drop height unless noted otherwise. Specimens which were not broken after impact from the designated drop height were broken in accordance with the Center Punch Fragmentation Test per ANSI Z97.1-2015.

Drop Height Classification

All specimens were impacted once from a drop height of 48 inches.

DROP HEIGHT CLASSIFICATION			
ANSI	CGSB	CPSC	DROP HEIGHT
Class A	Class A	Category II	48 in.

SECTION 8

TEST SPECIMEN DESCRIPTION

Manufacturer: Viewrail - Goshen, Indiana

Glazing Product Designation: Prototype

Overall Glazing Thickness: 1/2" (nominal)

Glazing Type: Tempered Transparent Glass (TTG)

Sample Dimensions: Impact: 34" wide x 76" high ($\pm 1/8"$)

Size Classification: Unlimited

Thickness Standard: ASTM C1036

SECTION 9

TEST RESULTS

Lab Temperature: 71°F

Duration of Pre-Conditioning @ 65 - 85°F: 24 Hours

Impact Test Results

SPECIMEN NUMBER	THICKNESS (inches)	TEST RESULTS (grams)	CENTER PUNCH (YES/NO)	ACCEPTANCE CRITERIA (grams)	RESULT (PASS/FAIL)
1	0.498	23	Yes	205	Pass
2	0.500	31	Yes	206	Pass
3	0.499	25	Yes	206	Pass
4	0.500	22	Yes	206	Pass

Acceptance Criteria: The 10 largest crack-free particles collected after specimen breakage shall weigh no more than 10 sq. in. of the original specimen.



130 Derry Court
York, Pennsylvania 17406
Telephone: 717-764-7700
Facsimile: 717-764-4129
www.intertek.com/building

TEST REPORT FOR VIEWRAIL
Report No.: K1004.02-119-37
Date: 09/03/19


SECTION 10 CONCLUSION

The specimens meet the test requirements of the referenced standards for the size classification listed.


SECTION 11 REVISION LOG

	DATE	PAGES	REVISION
0	09/03/19	N/A	Original Report Issue


Appendix B: System Components and Drawings

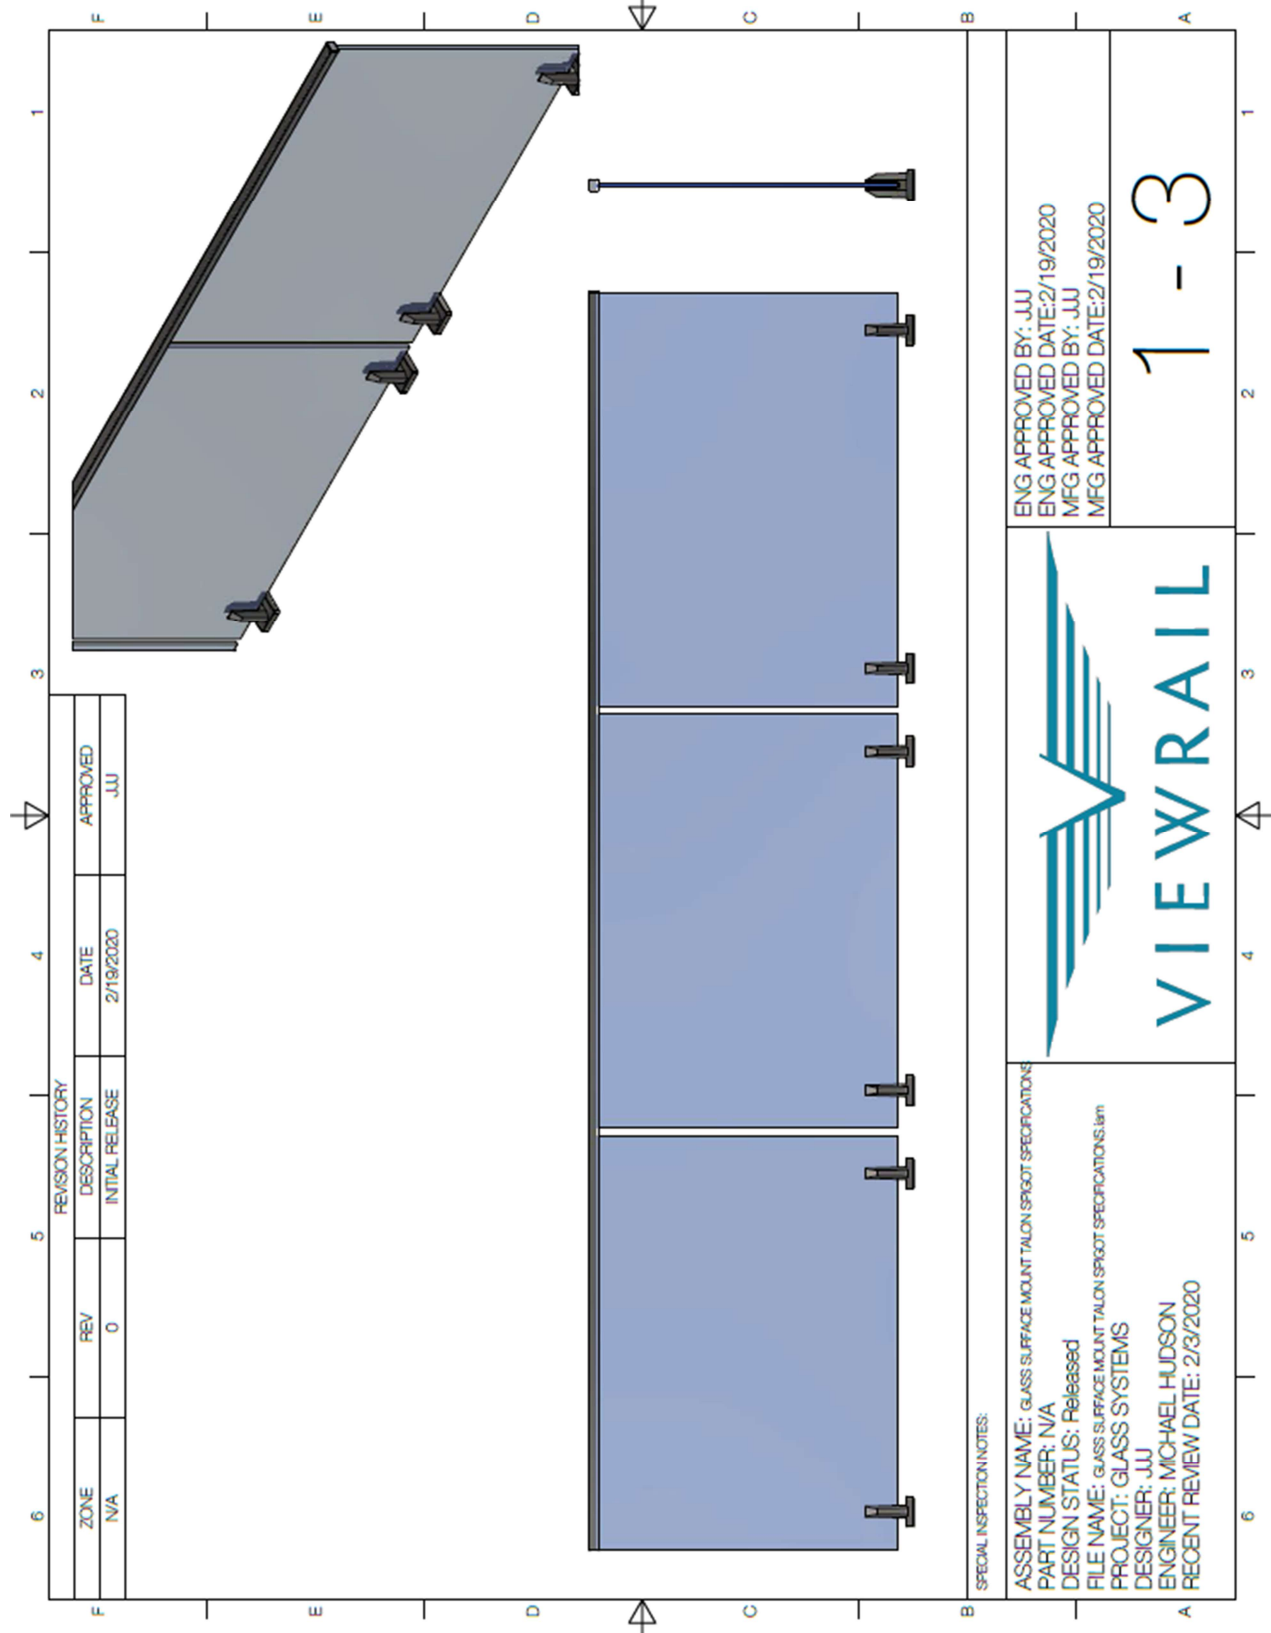


H&G Surface Mount Talon Glass Baluster Test Report

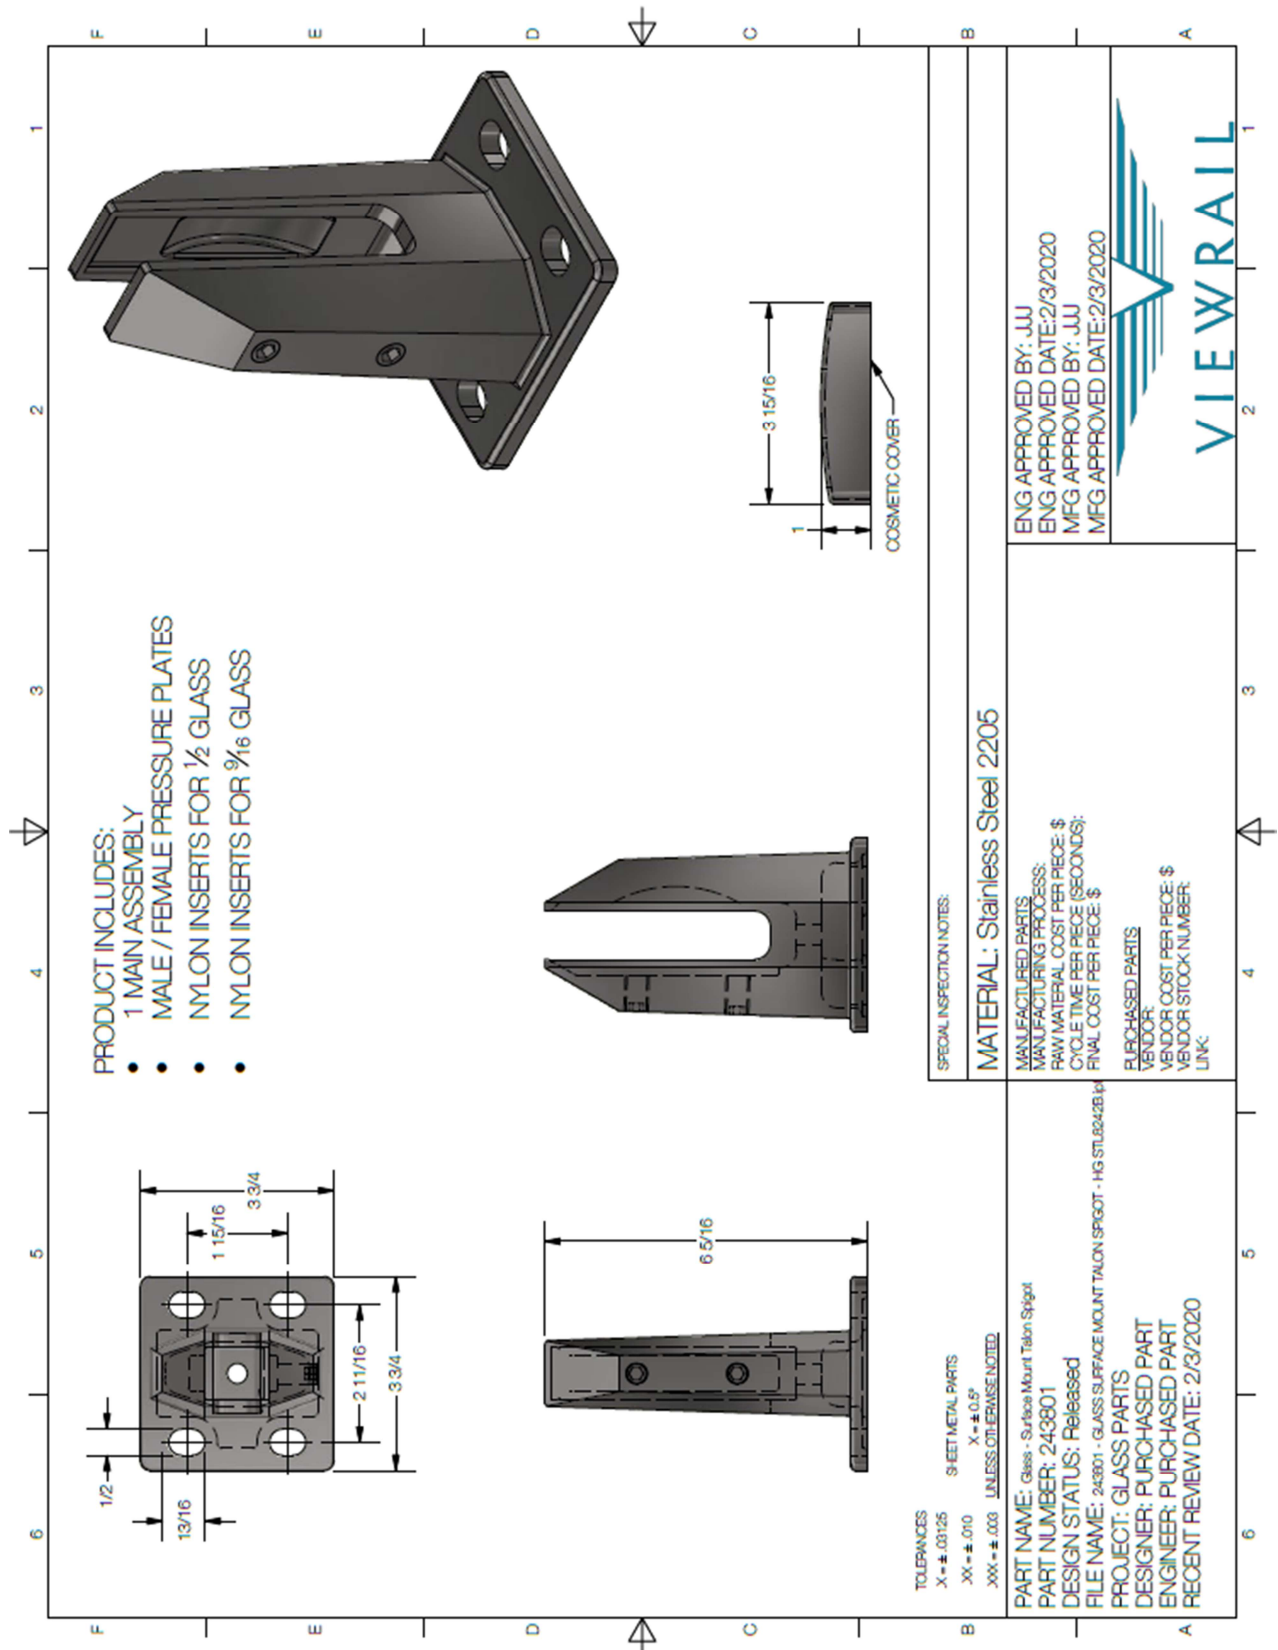

H&G Surface Mount Talon Glass Baluster Test Report

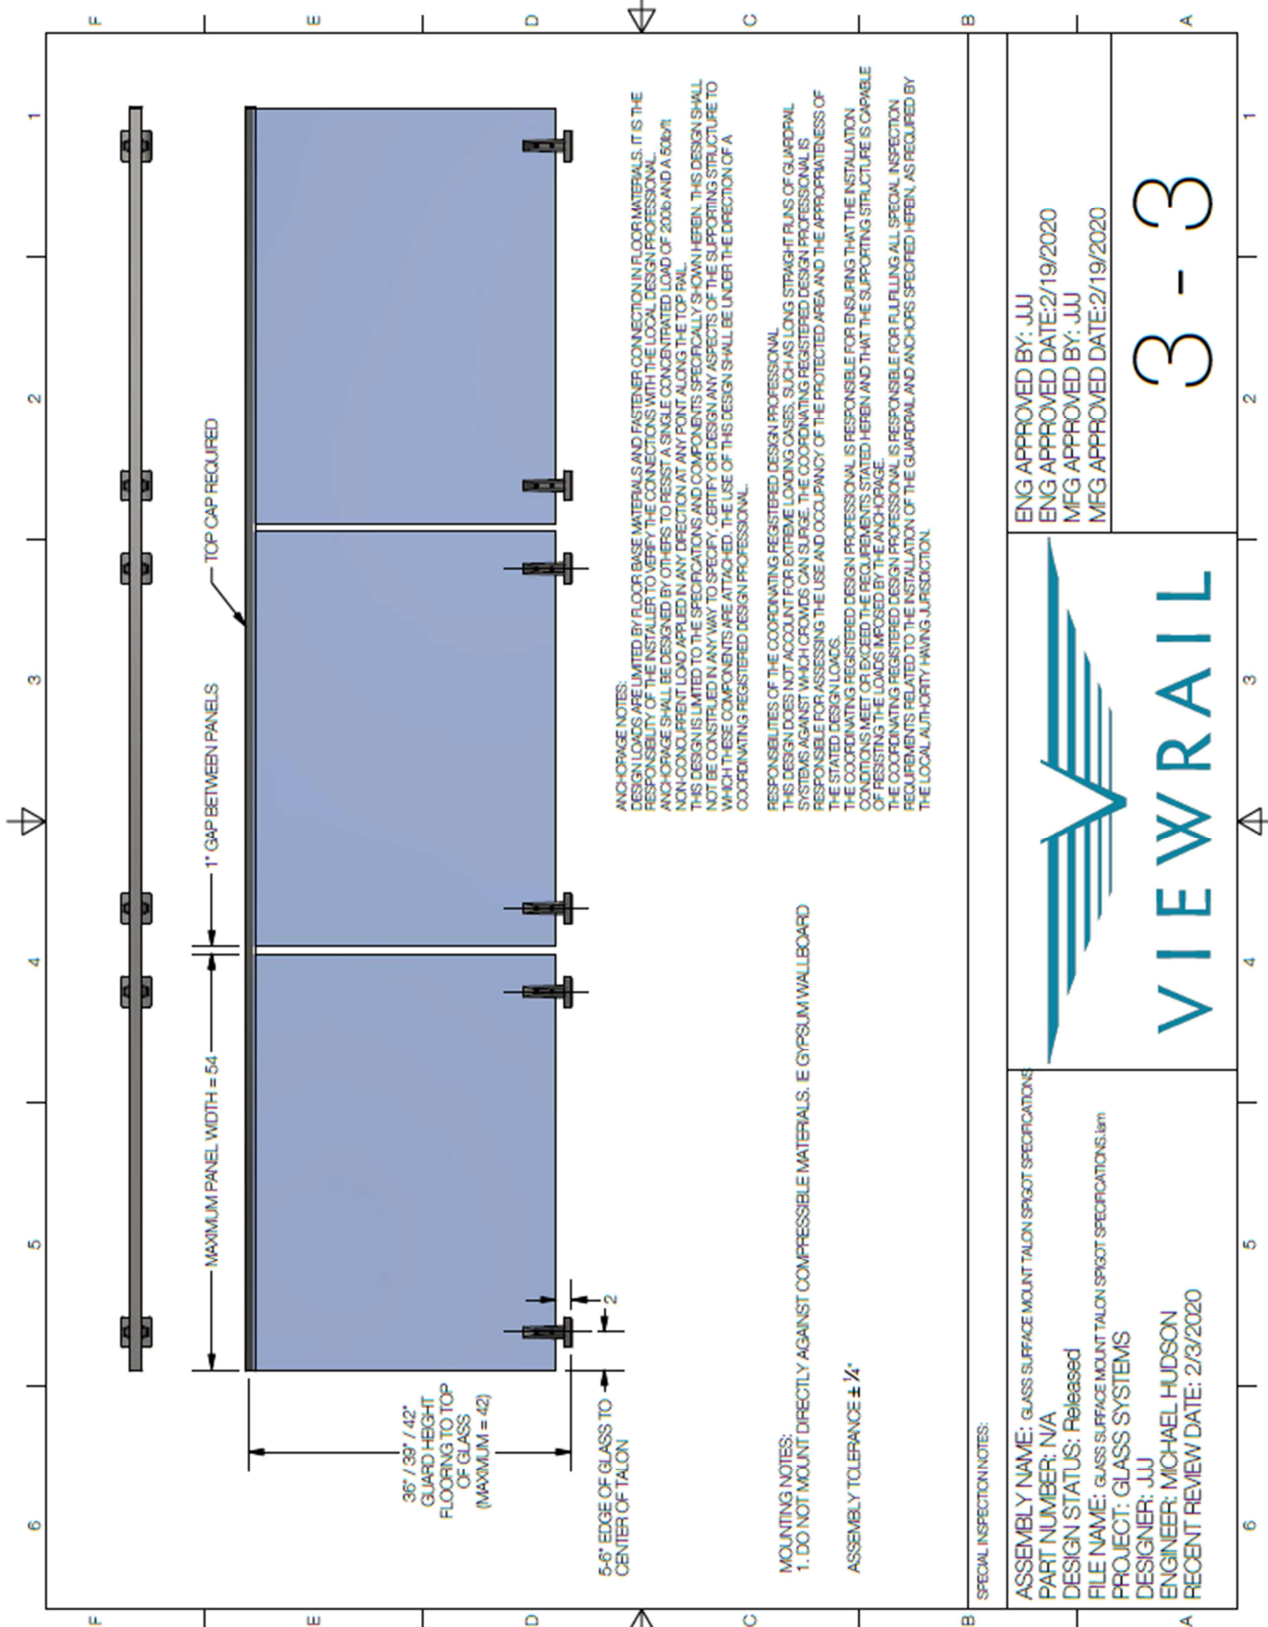

H&G Surface Mount Talon Glass Baluster Test Report

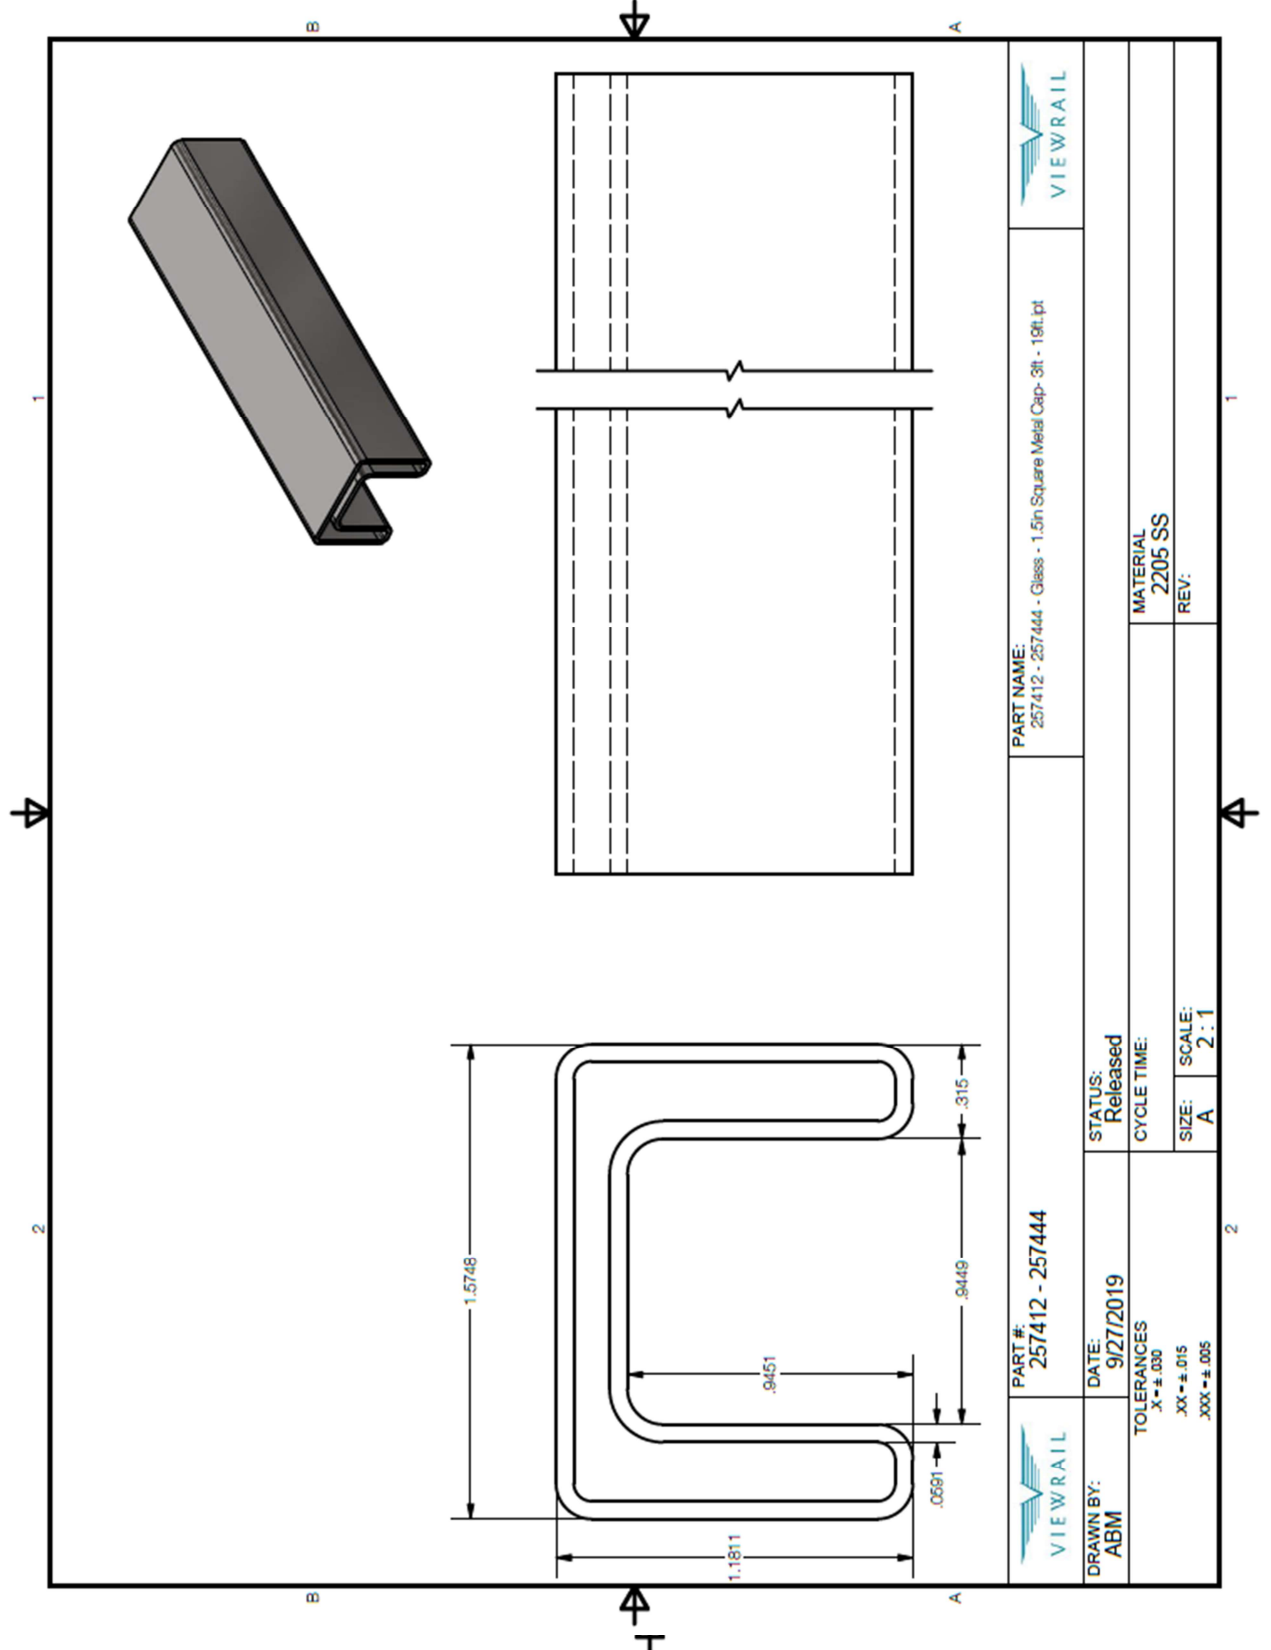

Appendix C: Manufacturer's Published Installation Instructions



Surface Mount Talon Spigot Installation Instructions



Before You Begin

Inspect area where the Spigots are being installed.
Ensure that your mounting surface has sufficient backing.
For most jobs, a minimum of 4" of backing material is recommended in order to securely mount your Spigots.

Protect All Finished Surfaces

At each phase of installation, be sure to protect your Spigots and glass panels from debris that can cause marring to their finished surfaces.

Items You'll Need

Viewrail Layout Drawing

Glass Installation Kit:

- (1) Bottle of Gyeon Glass Cleaner
- (1) Microfiber Cloth
- (1) #5 Allen Wrench
- (1) #4 Allen Wrench
- (1) 2" T-80 Drive Bit
- (1) Stainless Steel Wipes
- (1) Pair Glass Suction Cup Handles

Cordless Drill



Impact Driver

Pencil



Chalk Line

- ① Refer to your Layout Drawing to determine the mounting location for each of the spigots.

- ② Snap chalk line to mark where the glass will run. Mark Spigot locations according to your Layout Drawing.

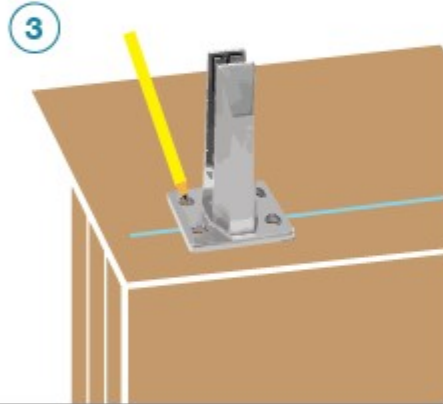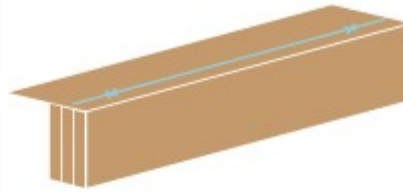

- ④ Predrill with 7/32" bit.

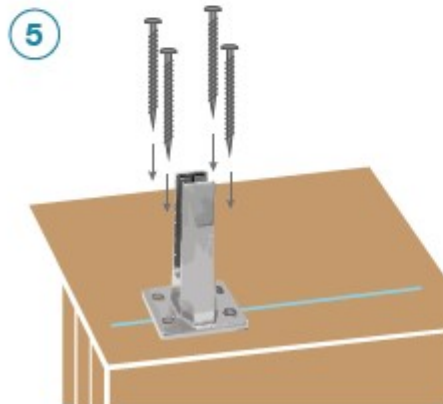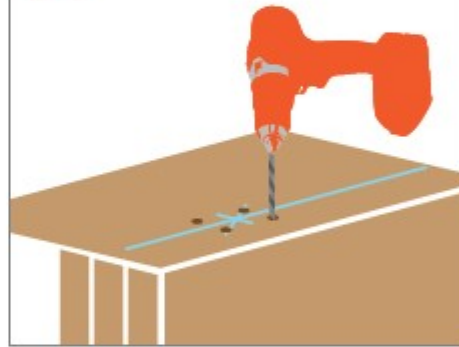

- ⑥ Slide foot cover on.

